


GENERAL NOTES

Refer to drawing 1398 (10)02 for lead parapet gutter locations. All lead gutter boarding and supporting carpentry is to be removed and re-laid to new 1:50 falls (minimum unless noted otherwise) and to be set out to align with existing chute outlets in the east elevation. Contractor to price for new boarding throughout but existing to be re-used wherever possible following close inspection by Architect once exposed (assume 50% salvage of existing). All supporting carpentry is to be removed if found to be in poor condition. New boards to be penny gap ex 150 x 32mm treated SW timber and carpentry to match existing as necessary.


All new lead work to BS EN 12588 to be fitted in accordance with BS 6915:2001 and the recommendations of the LSA (as defined and illustrated in the 'Rolled Lead Sheet, The Complete Manual').

All new lead work to Code 7 and all new falls between drips to be 1:50 minimum. All gutter drips to be a minimum of 60mm and gutter lengths not exceed 2500mm between drips. All levels shown are existing and proposed. Reinstated gutter outlet positions and levels are indicative and are to be checked on site by the Main Contractor following the stripping of the existing lead gutters.


Denotes proposed lead abutment flashings to be minimum 100mm upstand at the head of the gutter. Refer also to detail drawings 1398 (40)xx- (40)xx.

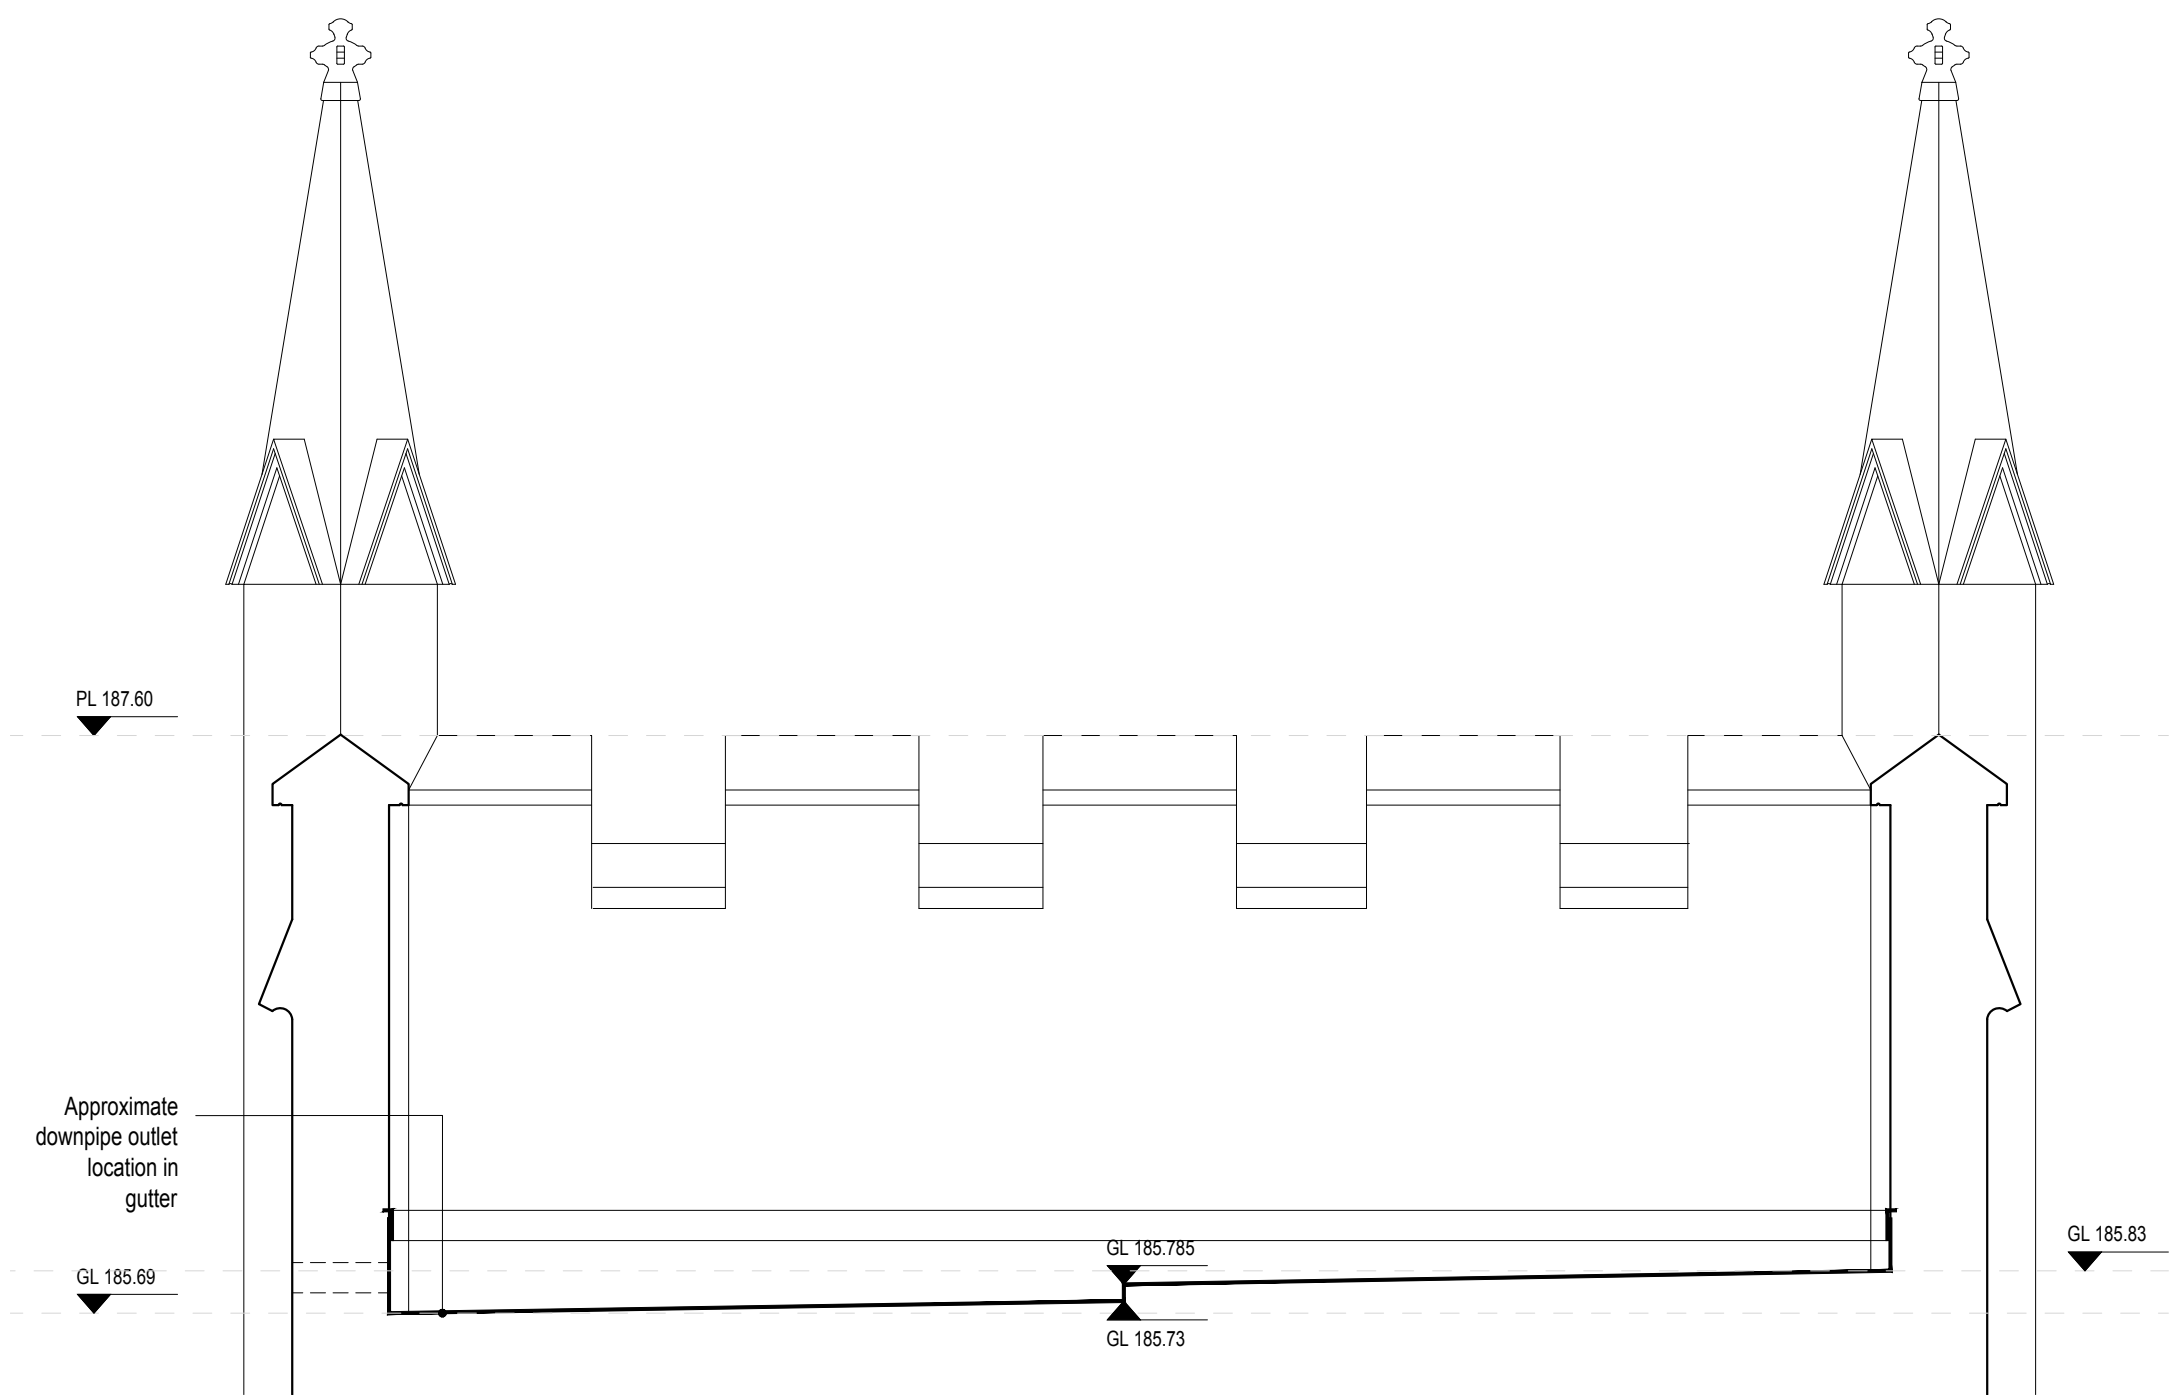


1 SOUTH GUTTER LOOKING SOUTH AS EXISTING
(30)03 1:25

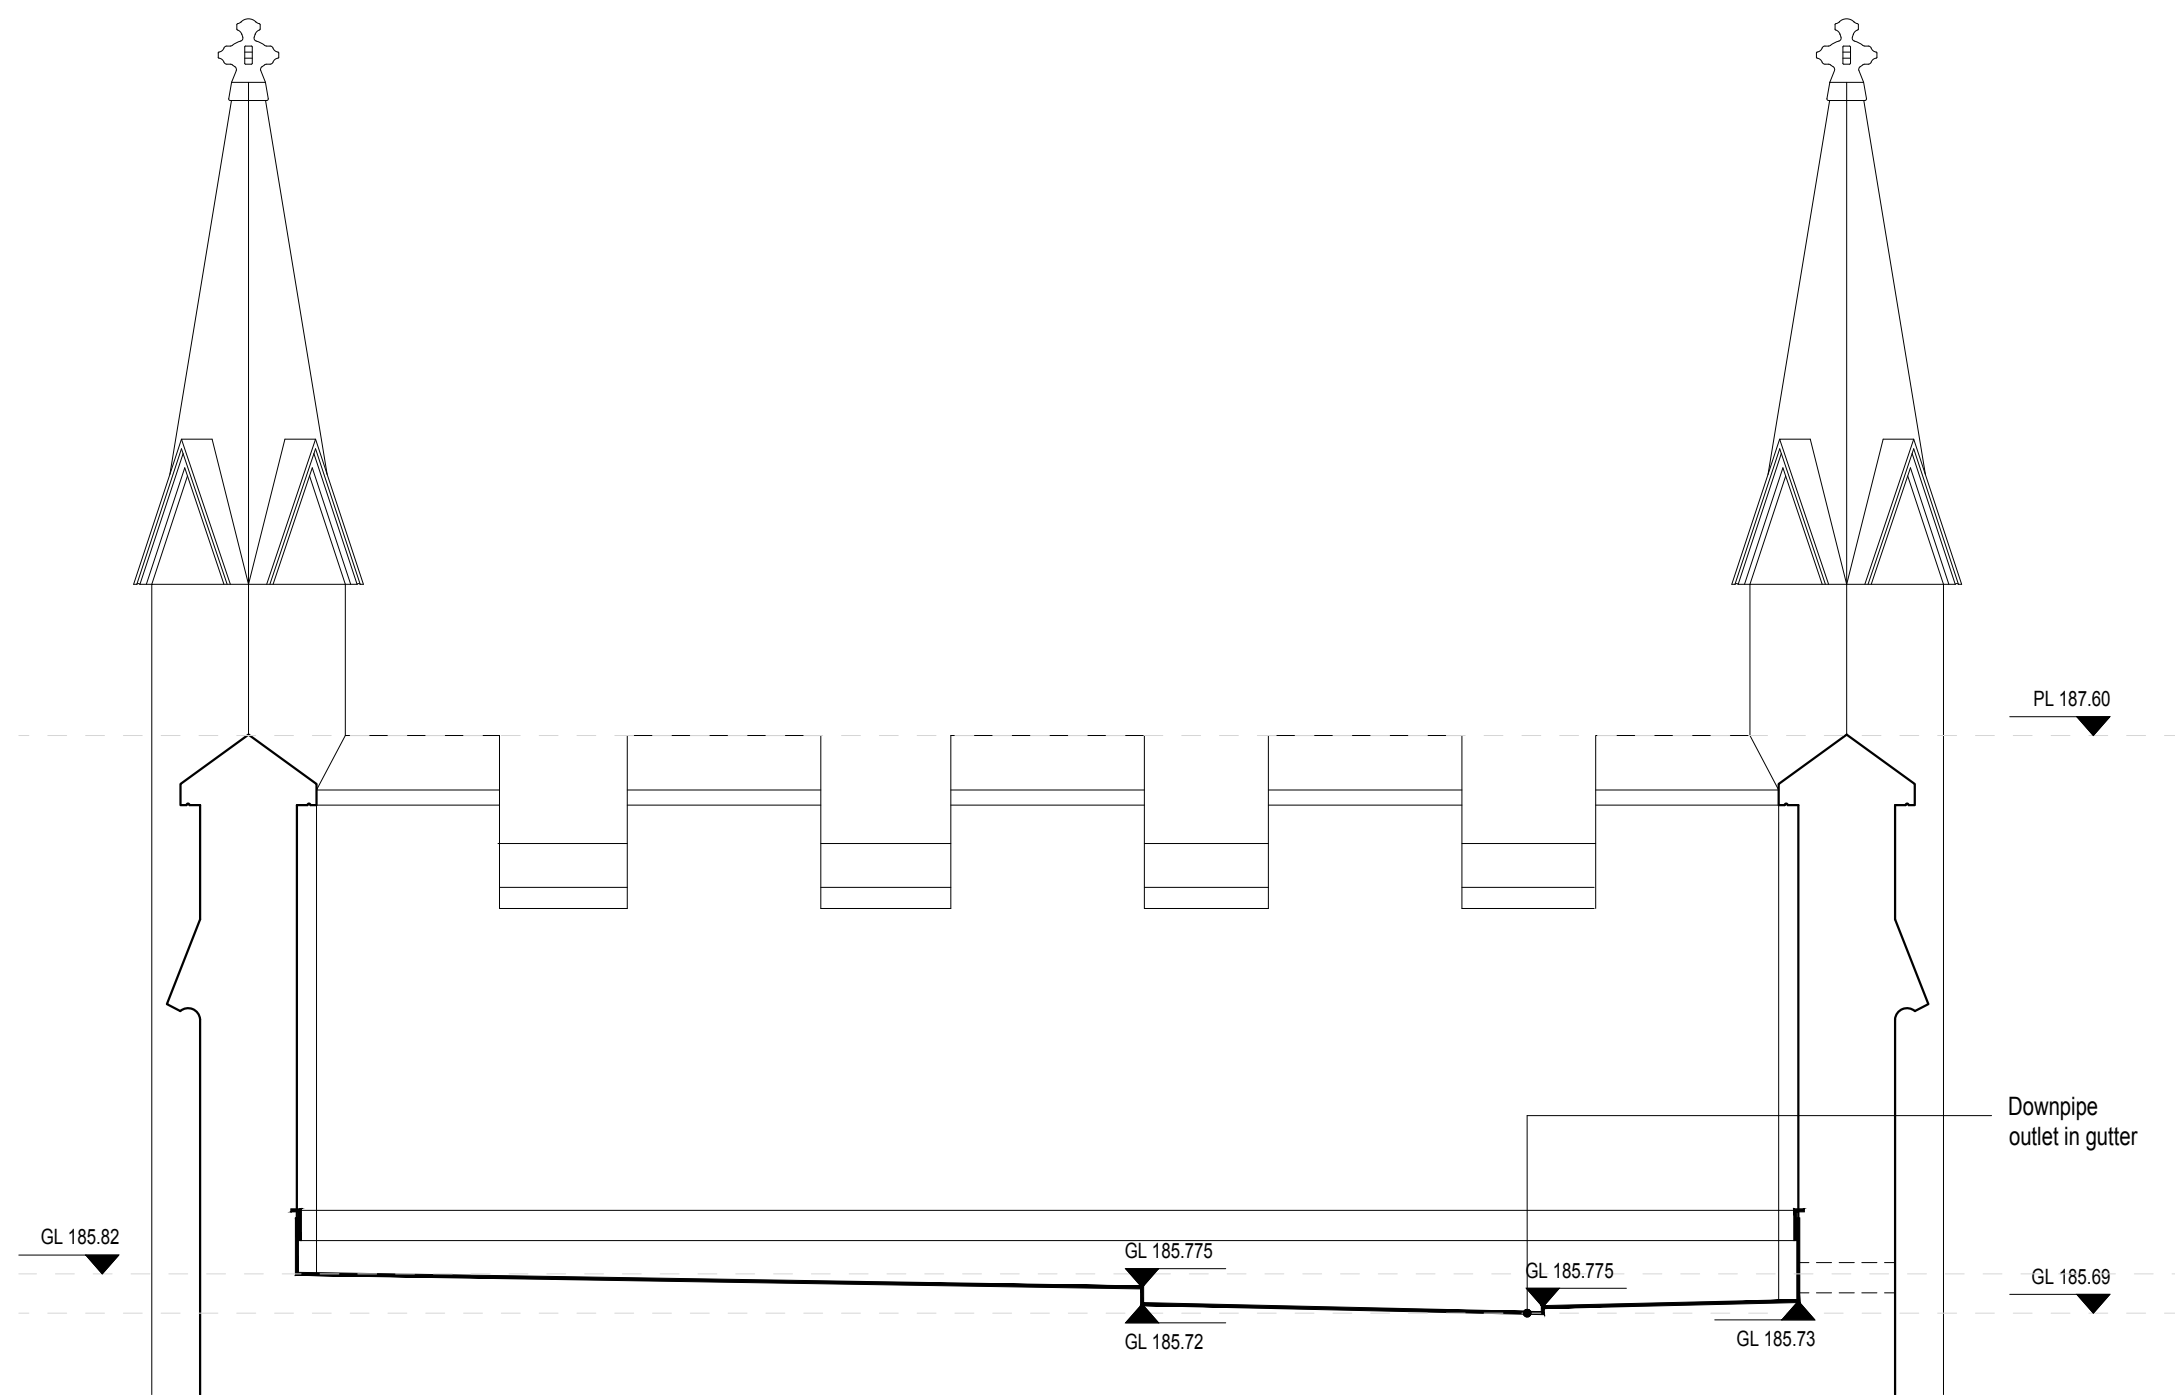

2 NORTH GUTTER LOOKING NORTH AS EXISTING
(30)03 1:25

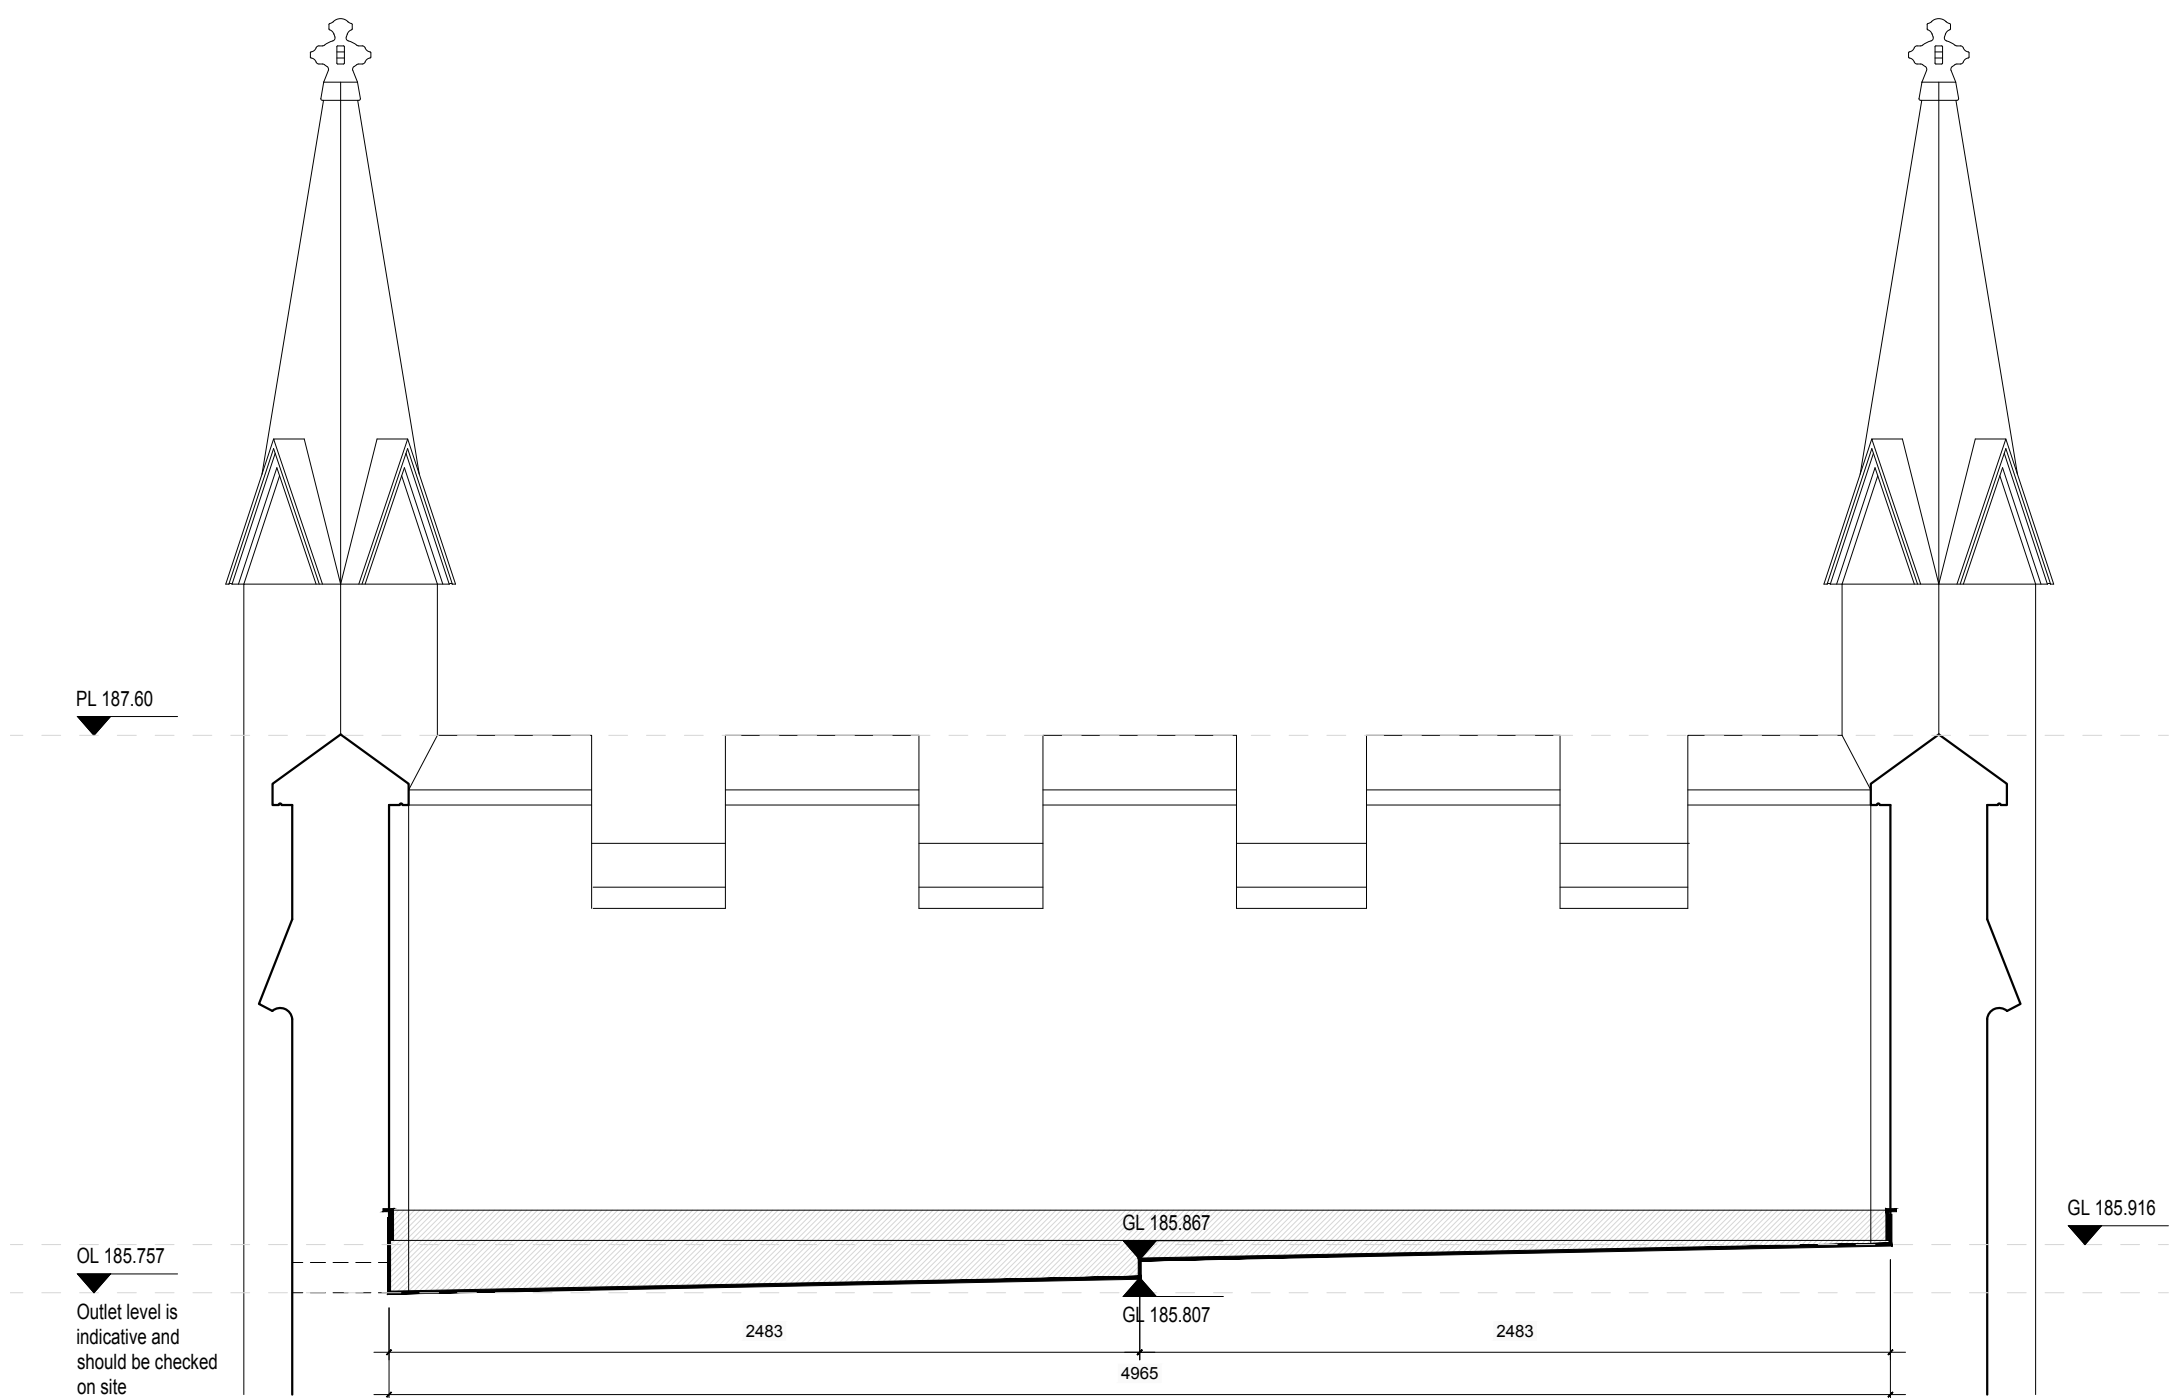

3 SOUTH GUTTER LOOKING SOUTH AS PROPOSED
(30)03 1:25

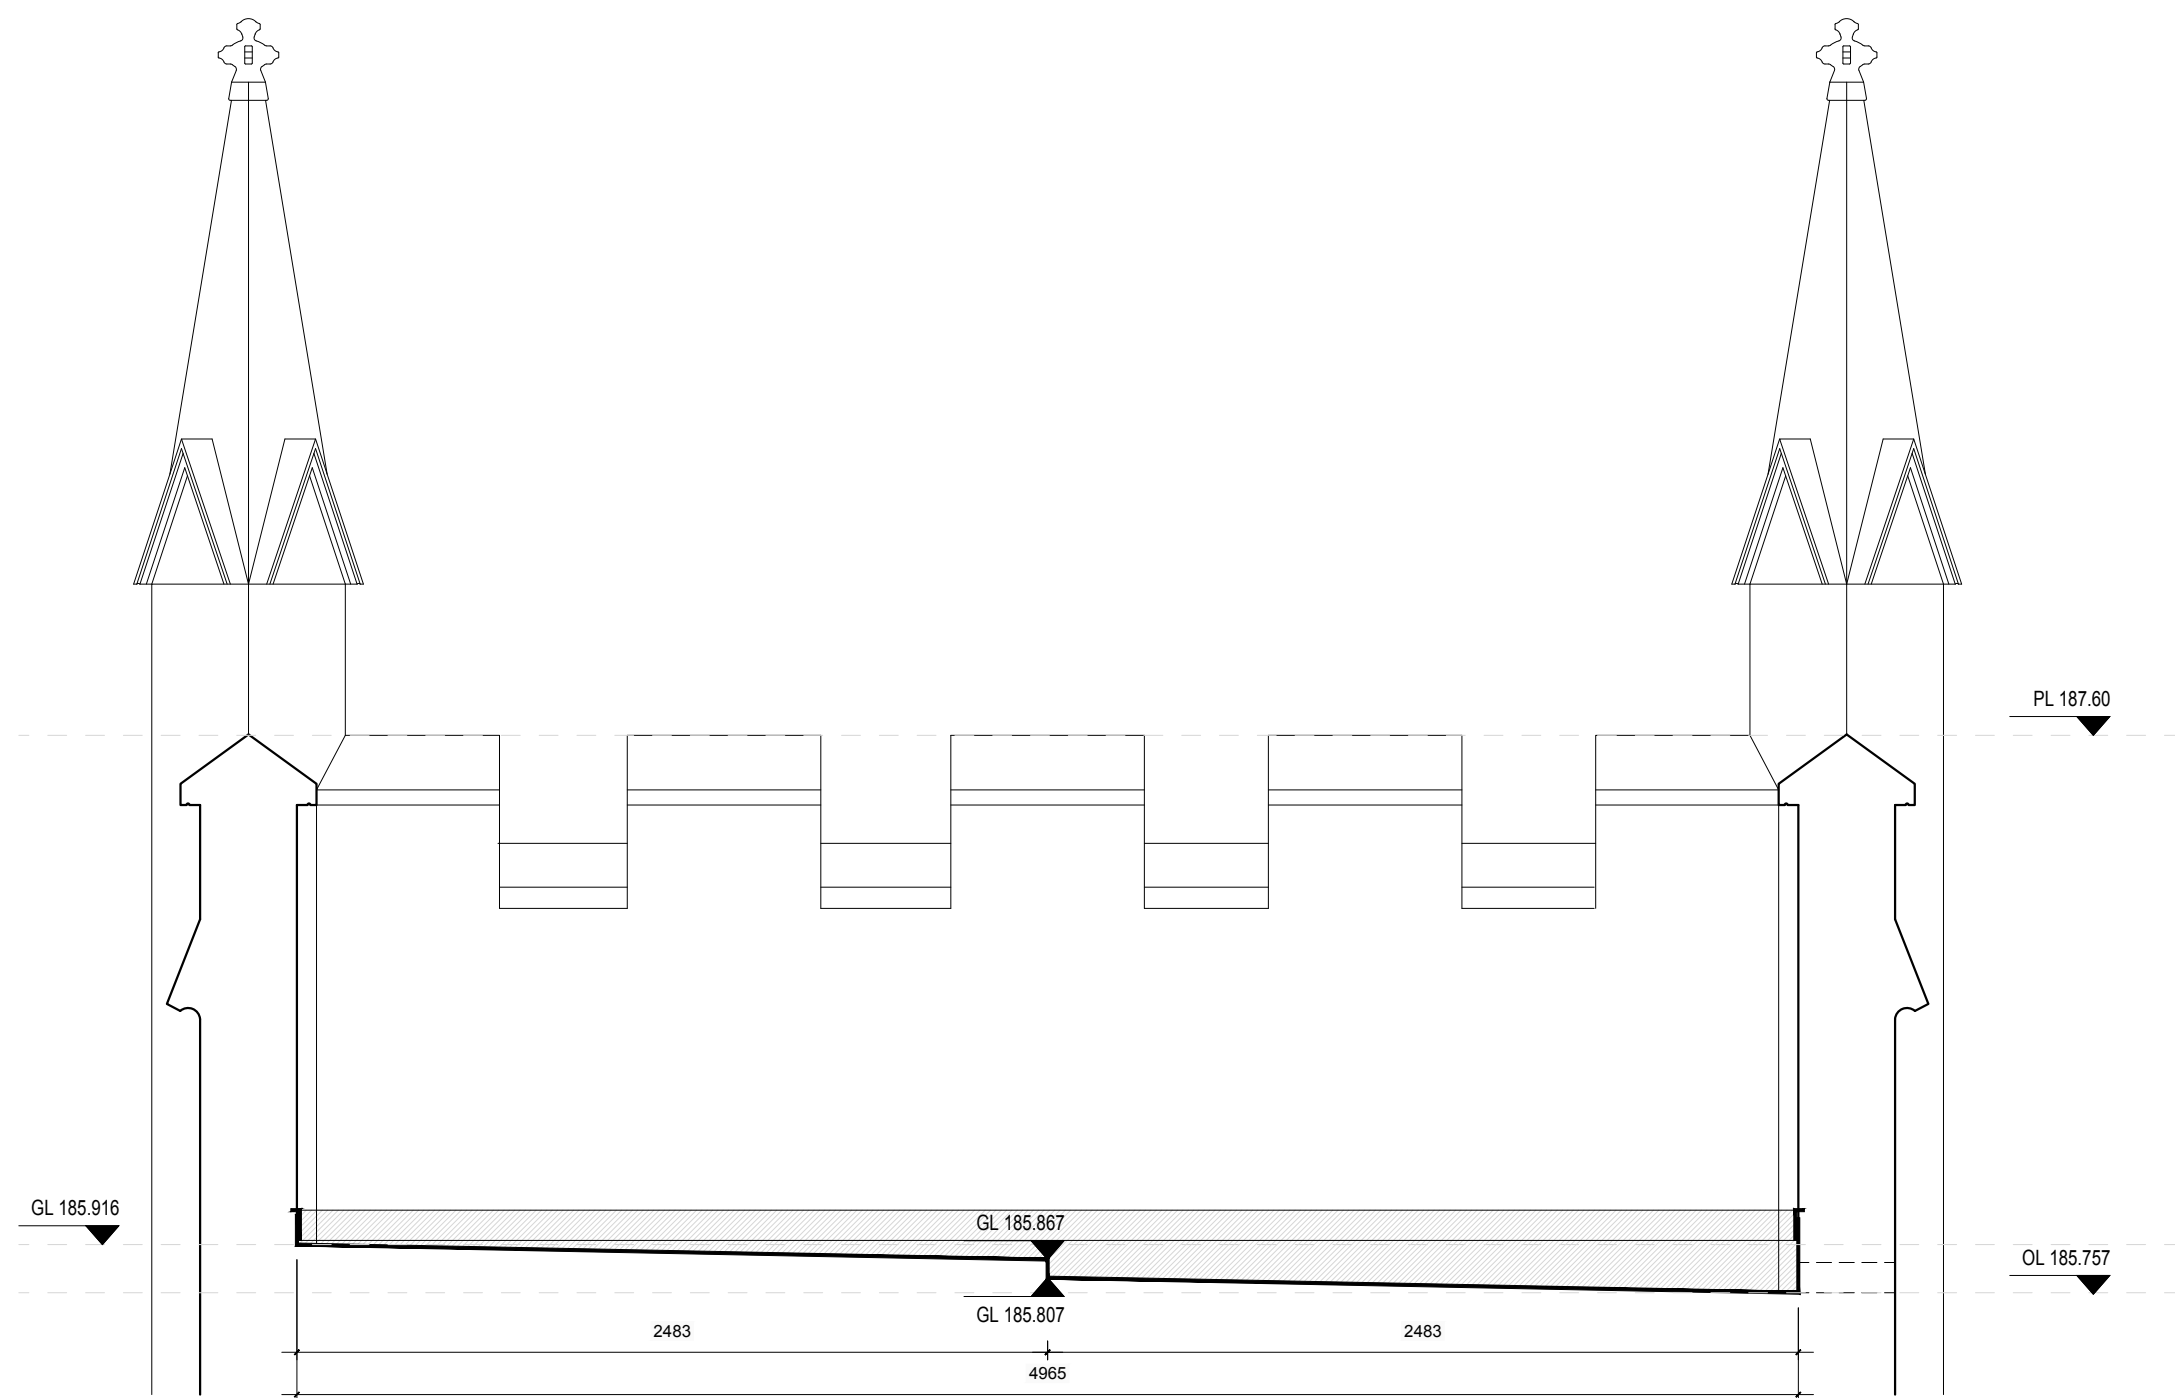

4 NORTH GUTTER LOOKING NORTH AS PROPOSED
(30)03 1:25

ISSUED FOR TENDER

Do not scale for construction purposes. The contractor shall check and verify all dimensions on site before ordering any components or fittings and any such are to be installed to the manufacturer's recommended details. Please note that these Building Regulations drawings show design intent only and construction is the responsibility of the contractor. All drawings are copyright of DNV Architects and shall not be reproduced without their consent.		Studios 12-13, 9 Bath Buildings, Bristol, BS6 5PT E info@dnva.co.uk W www.dnva.co.uk T 0117 914 8317		dittrichhudsonvasettiarchitects	
Job Title	Coleford Clock Tower	Dwg Title		Lead Stepped Gutter Sections as Existing and Proposed	
Client	Coleford Town Council	Dwg No		1398	(30)03
Scale	1:25 @ A1	Drawn	OF	Checked	OF
0 1 m		Job No		1398	(30)03